


NOTE:

ALL HYDRANTS TO BE SET PLUMB W/PUMPER NOZZLE FACING STREET OR AS DIRECTED BY S.W.U. ENGINEER.

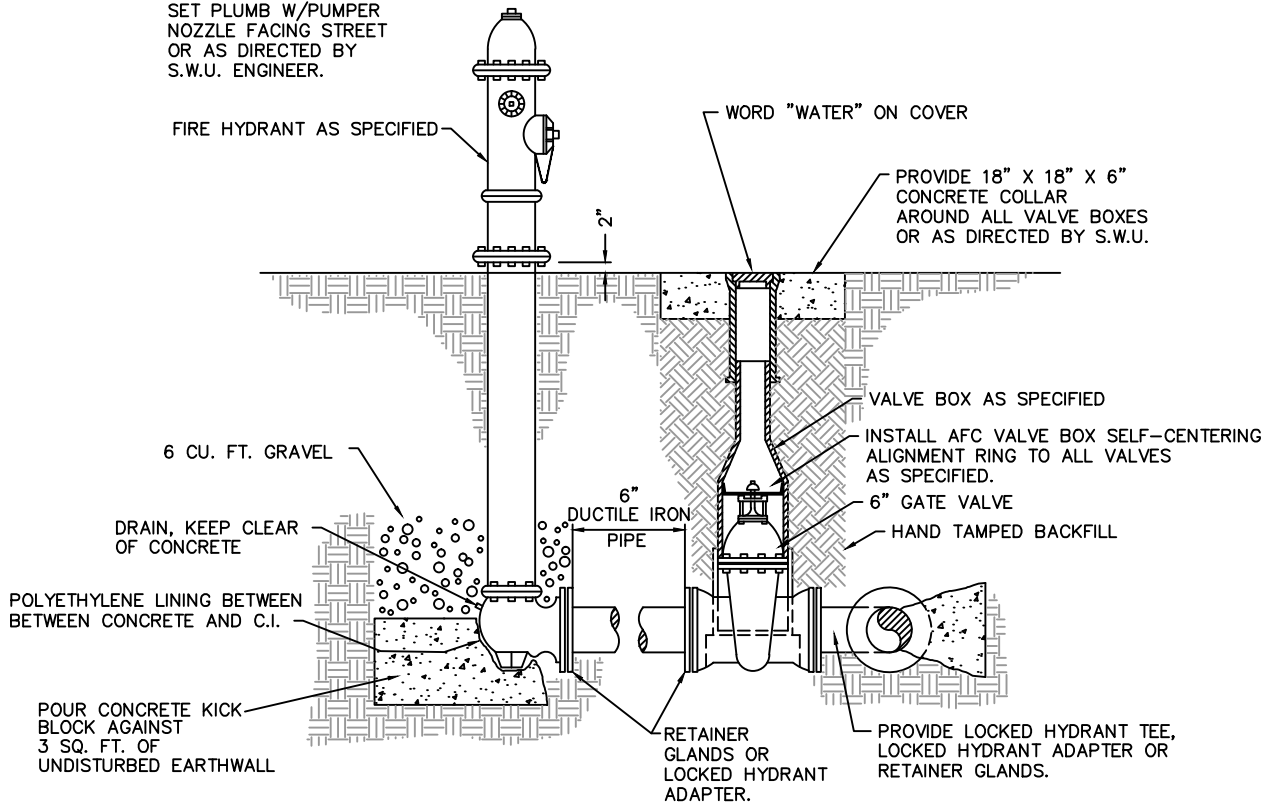

FIRE HYDRANT & GATE VALVE

N.T.S.