


NOTES:

1. ALL HYDRANTS TO BE SET PLUMB W/PUMPER NOZZLE FACING STREET OR AS DIRECTED BY S.W.U. ENGINEER
2. SEE DRAWING NUMBER FOR FIRE HYDRANT PLACEMENT.

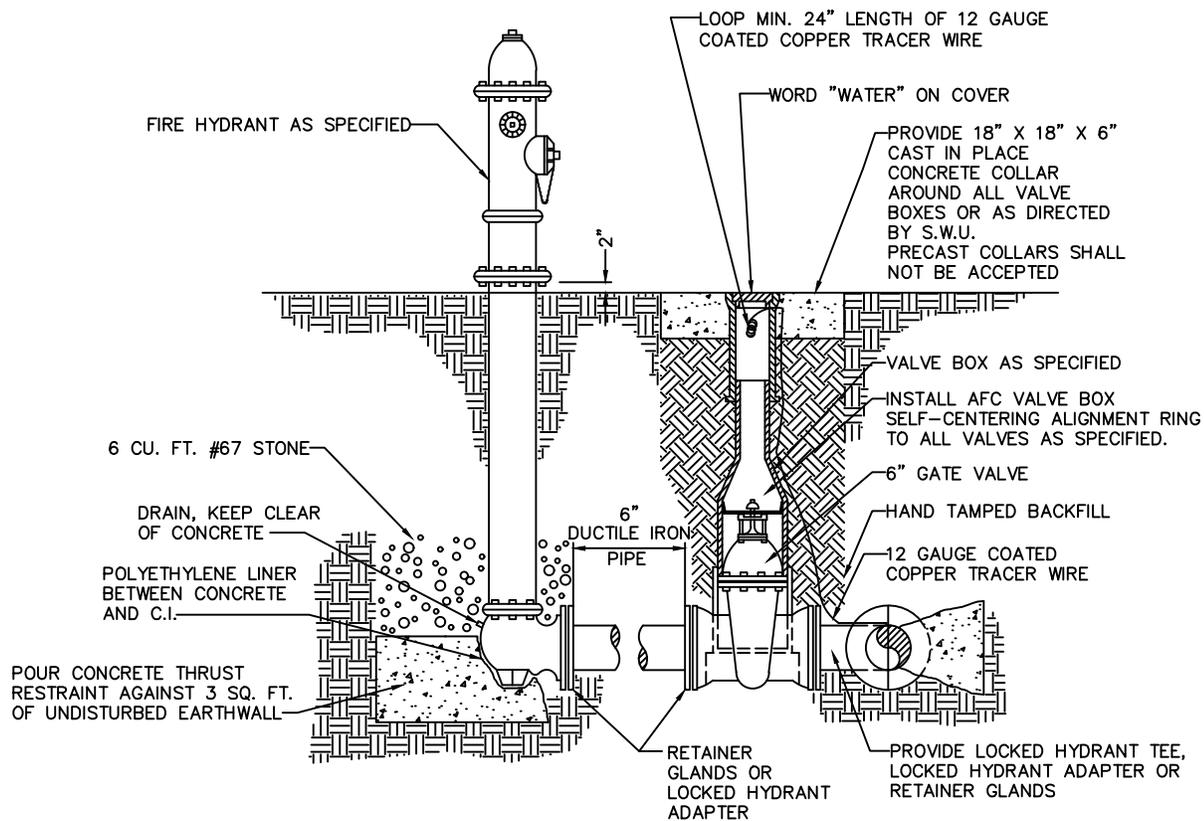

FIRE HYDRANT & GATE VALVE

N.T.S.
S-1