



**NOTES:**

THE CLASS 7 BASE MATERIAL SHALL BE BROUGHT UP EVENLY IN LIFTS NOT TO EXCEED 4" (LOOSE MEASUREMENT) AND COMPACTED WITH MECHANICAL EQUIPMENT TO AT LEAST 95% OF THE MAXIMUM DENSITY AS DETERMINED BY AASHTO 180.

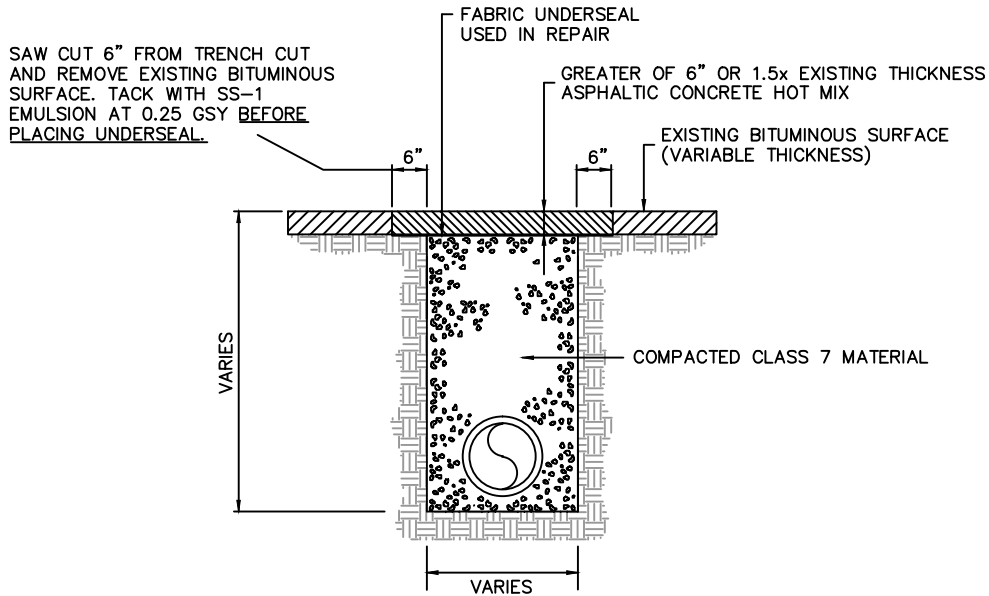

BITUMINOUS PAVEMENT REMOVAL  
WITH  
PERMANENT REPLACEMENT DETAIL

N.T.S.

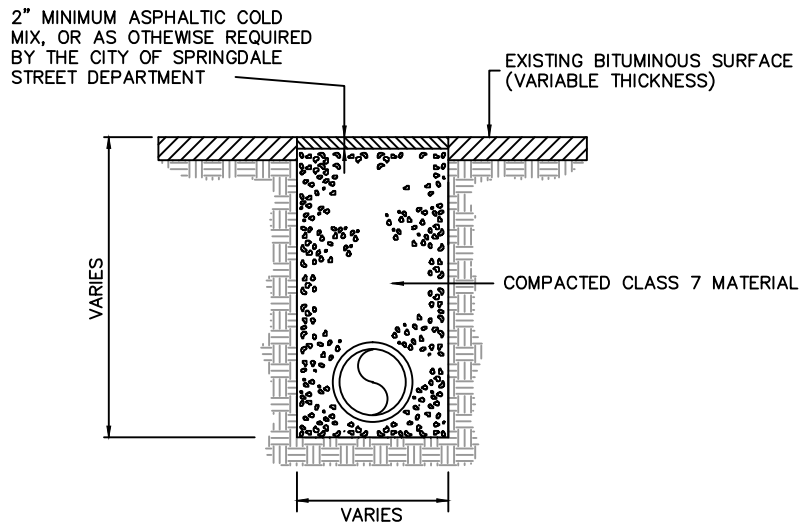

BITUMINOUS PAVEMENT REMOVAL  
WITH  
TEMPORARY REPLACEMENT

N.T.S.



526 OAK AVENUE • P.O. BOX 769 • SPRINGDALE, ARKANSAS • 72765-0769 • (479) 751-5751

STANDARD DETAILS  
FOR  
WATER AND SEWER CONSTRUCTION

DRAWN BY: JNK

DRAWING NO: S-21

DATE: AUGUST 2014