


NOTE: ALL MATERIALS INSTALLED IN POTABLE WATER SYSTEMS ARE REQUIRED TO COMPLY WITH THE FEDERAL DEFINITION OF "LEAD FREE" CONTAINED IN PUBLIC LAW 111-380.

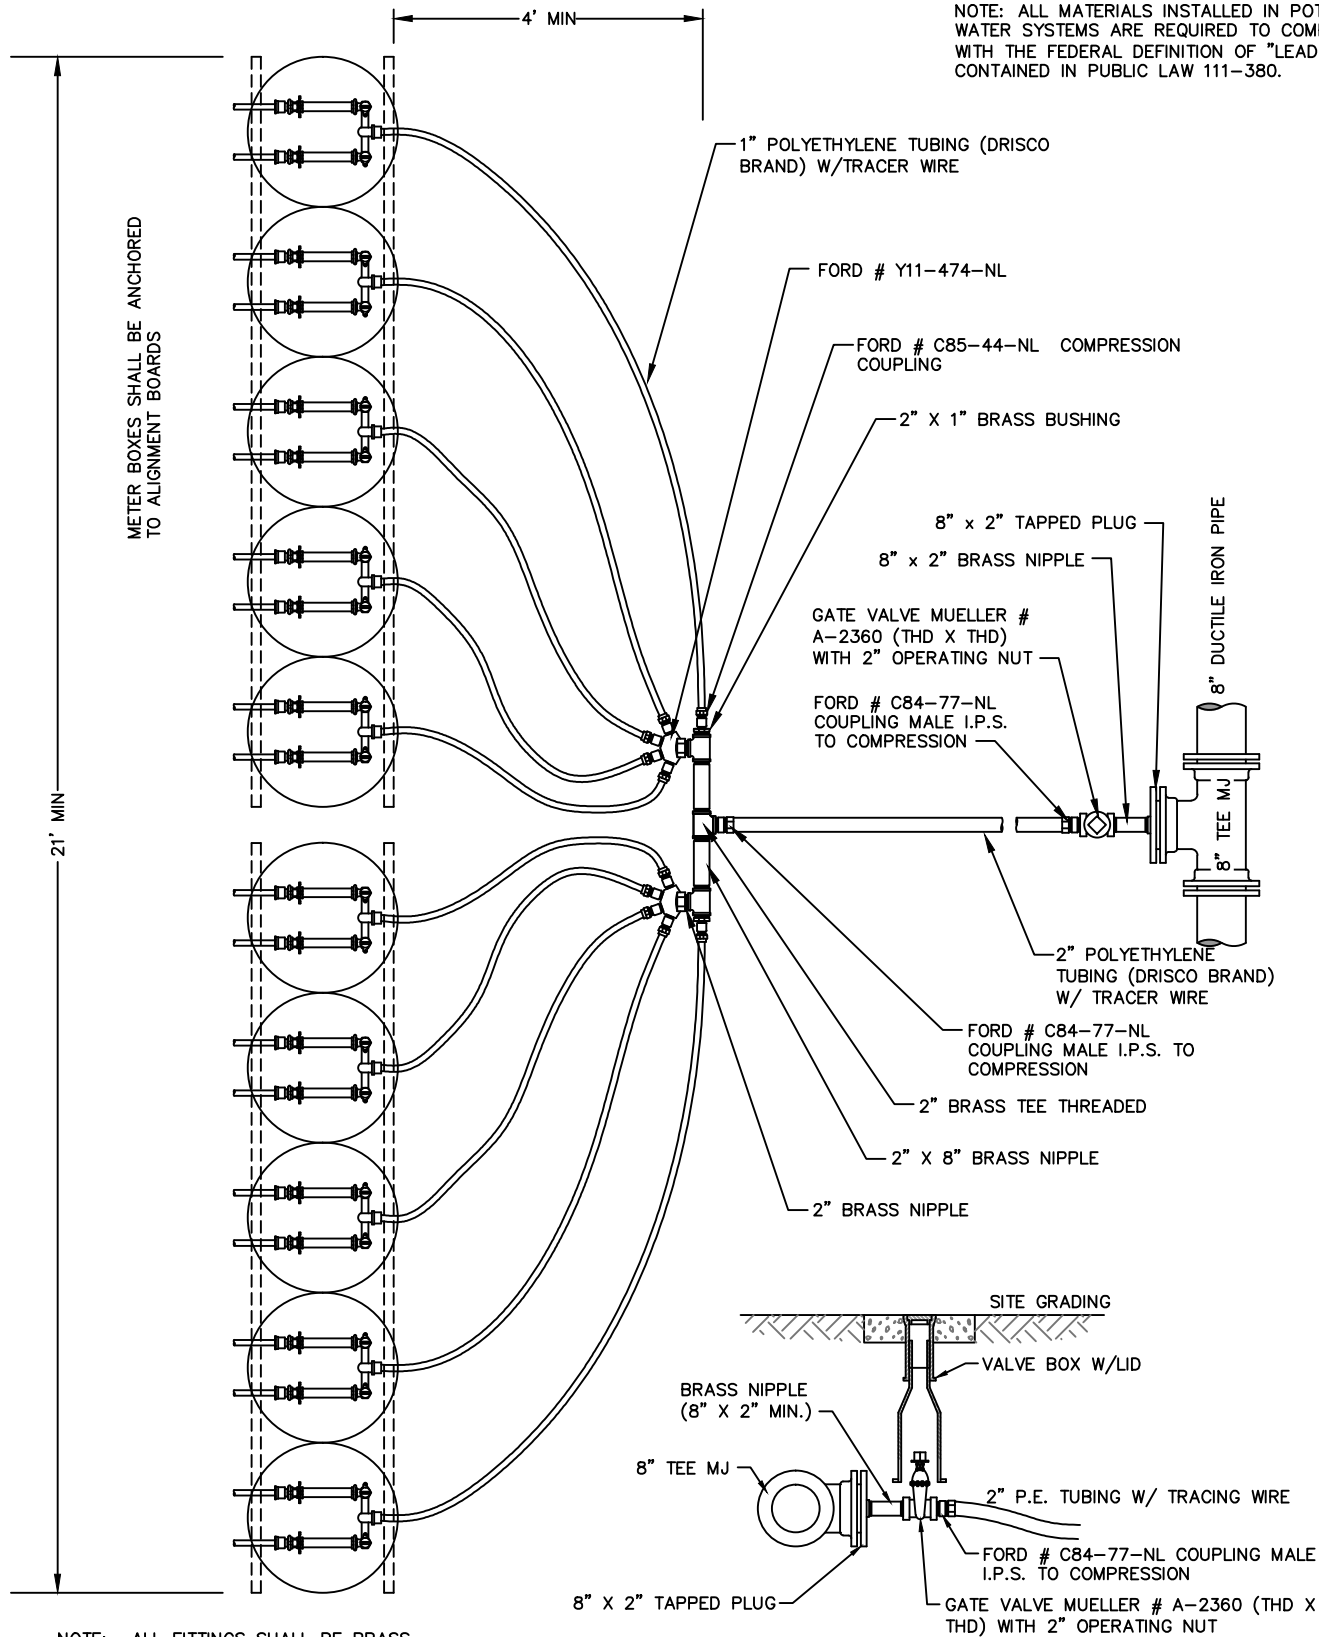

NOTE: ALL FITTINGS SHALL BE BRASS

METER ARRAY ARRANGEMENT #1

N.T.S.



526 OAK AVENUE • P.O. BOX 769 • SPRINGDALE, ARKANSAS • 72765-0769 • (479) 751-5751

MISCELLANEOUS DETAILS
FOR
WATER AND SEWER CONSTRUCTION

DRAWN BY:

CAG

DRAWING NO:

M-8

DATE:

OCTOBER 2014