


**NOTES:**

1. ALL HYDRANTS TO BE SET PLUMB W/PUMPER NOZZLE FACING STREET OR AS DIRECTED BY S.W.U. ENGINEER
2. SEE DRAWING NUMBER FOR FIRE HYDRANT PLACEMENT.

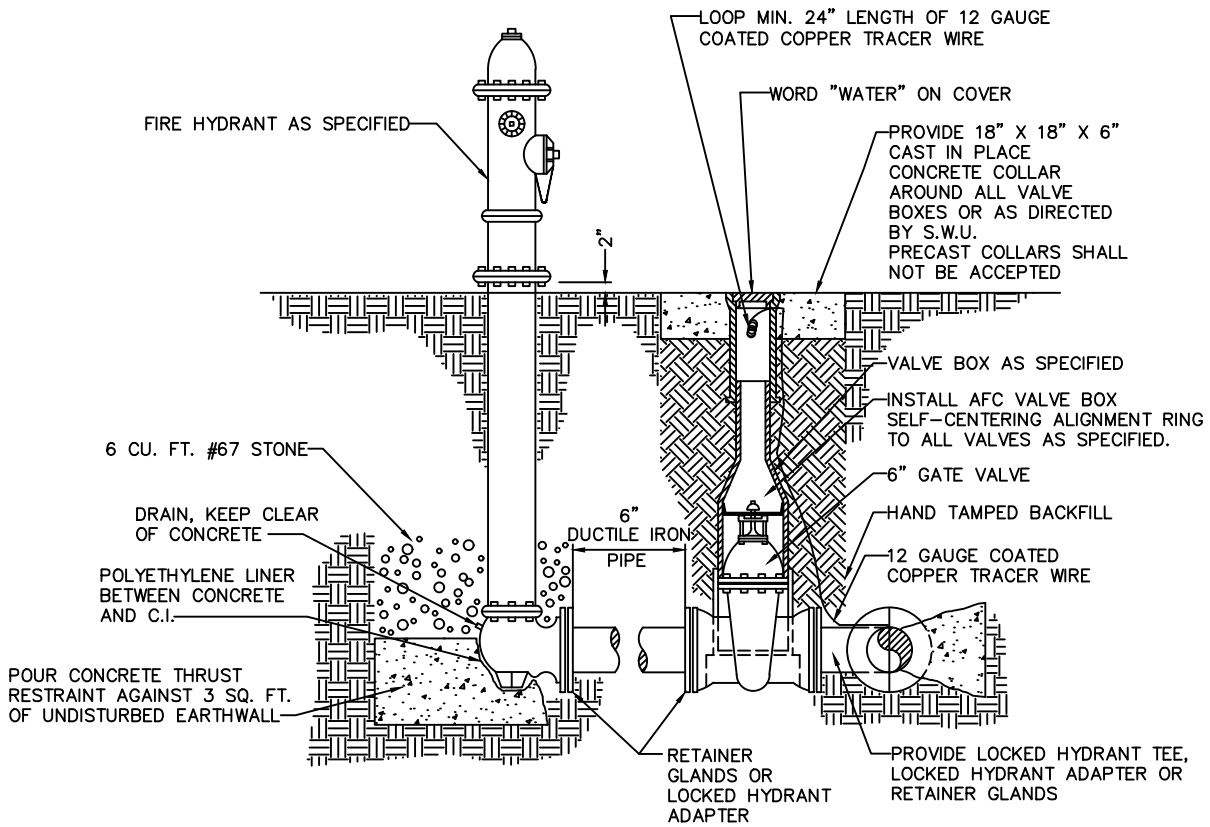

**FIRE HYDRANT & GATE VALVE**

N.T.S.  
S-1